

Your configuration

MIA
OOOI



Your configuration code is

M1.I.0.0.0.0.3.3

The transmission of the configuration code is an important piece of information for identifying your desired variant both in the quotation phase and in the order phase.

Selection

Housing length [mm]


Housing diameter [mm]

Technical data

Description	Ø 90mm	Ø 140mm
Avg. rot. speed [min-1]	200	150
Max. Speed [min-1]	400	300
Protection class according to IEC 60529	IP 50	
Operating temperatur [°C]	-20 to +70	
Lifetime up to [m rev]	50	
Current load [A]	Max. 63	
Voltage load [V AC]	Max. 630	
Cable length rotor [m]	3	
Cable length stator [m]	3	

Quantity	Name	Description	Width	V	A	Ways
1	Ground track dummy	Used instead of a PE-track	1	0	0	1
1	Module I (Profibus)	Profibus (12 Mbit). Profibus + 8 signals (30V/3A).	1	30	3	Profibus + 8
1	Dummy module	Dummy module to fill out empty space	1	0	0	0

Circuit diagram

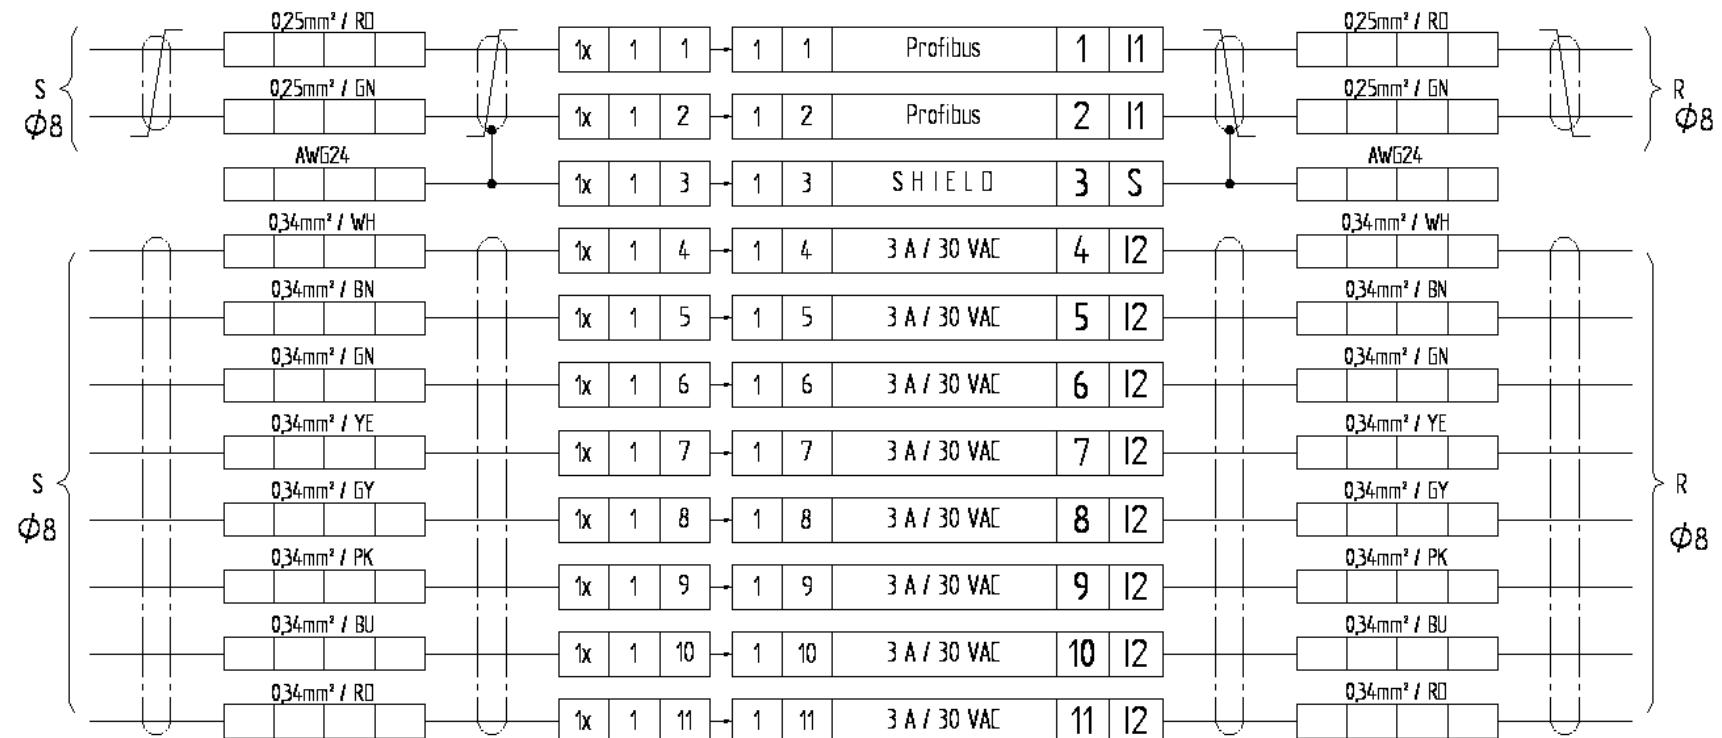

Drawing

